


# MONTHLY SYSTEM PEAK DEMAND

( in MW)



MONTH	LUZON														
	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015
JAN	5,119	5,212	5,282	5,511	5,471	5,619	5,819	5,972	6,118	6,407	6,594	7,027	7,079	7,121	7,315
FEB	5,157	5,056	5,345	5,701	5,853	5,776	6,115	6,094	6,452	6,878	6,877	7,162	7,214	7,545	7,610
MAR	5,384	5,424	5,705	6,065	6,210	6,186	6,157	6,211	6,642	7,057	7,006	7,503	7,720	7,655	7,878
APR	5,523	5,589	6,149	6,218	6,266	6,222	6,581	6,663	6,845	7,305	7,056	7,885	8,178	8,267	8,727
MAY	5,646	5,823	6,109	6,323	6,443	6,466	6,643	6,485	6,829	7,656	7,538	7,889	8,305	8,717	8,928
JUN	5,447	5,750	5,831	5,978	6,348	6,339	6,619	6,674	6,928	7,646	7,552	7,709	8,208	8,607	8,881
JUL	5,281	5,652	5,856	6,061	6,039	6,221	6,464	6,559	6,848	7,240	7,438	7,574	8,030	8,265	8,826
AUG	5,313	5,604	5,813	5,906	6,107	6,094	6,369	6,403	6,863	7,009	7,200	7,242	7,755	8,230	8,889
SEP	5,364	5,559	5,885	6,097	5,998	6,195	6,416	6,496	6,873	7,057	7,107	7,293	7,966	8,005	8,738
OCT	5,460	5,687	5,878	5,916	5,843	5,845	6,155	6,627	6,530	7,074	7,255	7,421	7,564	7,993	8,624
NOV	5,319	5,712	5,957	5,987	5,889	5,974	6,137	6,492	6,662	6,851	7,223	7,425	7,488	8,033	8,498
DEC	5,305	5,707	5,904	5,900	5,910	5,813	6,195	6,376	6,575	6,946	7,178	7,395	7,670	7,996	8,487
<b>MAX</b>	<b>5,646</b>	<b>5,823</b>	<b>6,149</b>	<b>6,323</b>	<b>6,443</b>	<b>6,466</b>	<b>6,643</b>	<b>6,674</b>	<b>6,928</b>	<b>7,656</b>	<b>7,552</b>	<b>7,889</b>	<b>8,305</b>	<b>8,717</b>	<b>8,928</b>
<b>% AAGR</b>	<b>3.60</b>	<b>3.13</b>	<b>5.60</b>	<b>2.83</b>	<b>1.90</b>	<b>0.36</b>	<b>2.74</b>	<b>0.47</b>	<b>3.80</b>	<b>10.51</b>	<b>(1.36)</b>	<b>4.46</b>	<b>5.27</b>	<b>4.96</b>	<b>2.42</b>

Source of Data: TransCo and NGCP

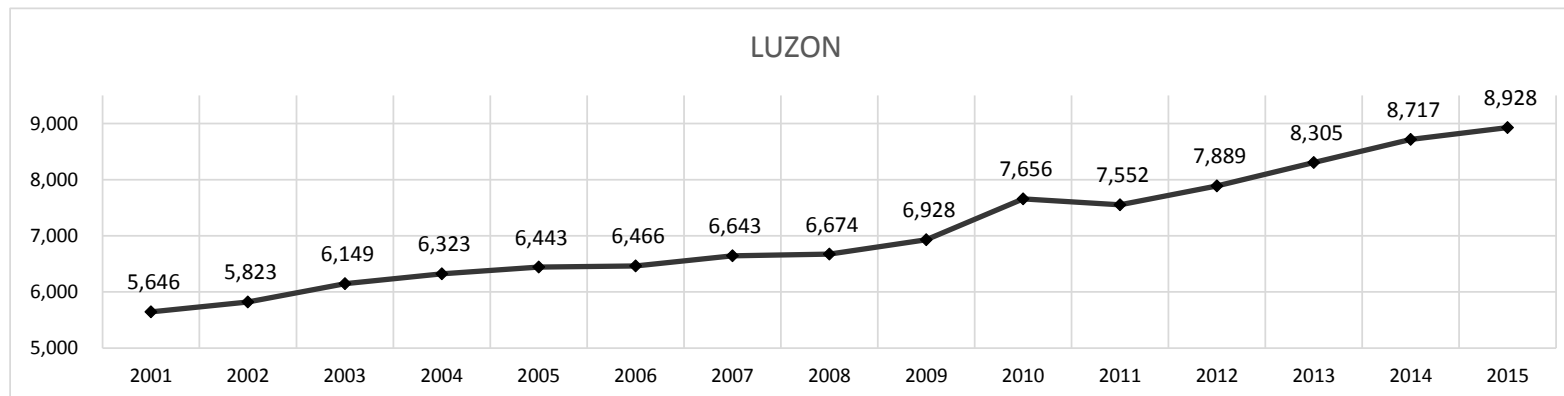

# MONTHLY SYSTEM PEAK DEMAND

( in MW)




MONTH	VISAYAS														
	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015
JAN	761	781	797	866	890	906	946	1,067	1,122	1,219	1,324	1,391	1,463	1,331	1,476
FEB	747	760	792	839	892	929	969	1,069	1,159	1,199	1,356	1,386	1,446	1,362	1,479
MAR	755	765	822	878	899	949	972	1,092	1,166	1,254	1,370	1,370	1,528	1,411	1,528
APR	794	826	828	889	916	964	1,007	1,112	1,193	1,308	1,431	1,447	1,548	1,499	1,630
MAY	777	842	837	896	928	968	1,015	1,090	1,204	1,364	1,405	1,464	1,572	1,606	1,618
JUN	773	818	858	857	926	961	1,078	1,089	1,204	1,344	1,399	1,449	1,555	1,636	1,562
JUL	780	803	817	880	931	977	1,090	1,105	1,201	1,323	1,398	1,440	1,543	1,511	1,584
AUG	778	793	832	889	919	951	1,100	1,127	1,214	1,310	1,415	1,480	1,207	1,579	1,596
SEP	826	790	834	894	911	976	1,094	1,128	1,206	1,341	1,414	1,456	1,547	1,528	1,625
OCT	798	780	857	904	917	967	1,088	1,174	1,215	1,333	1,435	1,489	1,520	1,517	1,705
NOV	799	790	897	952	943	984	1,101	1,176	1,241	1,402	1,462	1,502	1,518	1,610	1,768
DEC	813	842	924	955	967	997	1,102	1,165	1,231	1,431	1,481	1,551	1,350	1,526	1,727
<b>MAX</b>	<b>826</b>	<b>842</b>	<b>924</b>	<b>955</b>	<b>967</b>	<b>997</b>	<b>1,102</b>	<b>1,176</b>	<b>1,241</b>	<b>1,431</b>	<b>1,481</b>	<b>1,551</b>	<b>1,572</b>	<b>1,636</b>	<b>1,768</b>
<b>% AAGR</b>	<b>10.28</b>	<b>1.94</b>	<b>9.74</b>	<b>3.31</b>	<b>1.28</b>	<b>3.09</b>	<b>10.61</b>	<b>6.68</b>	<b>5.52</b>	<b>15.31</b>	<b>3.49</b>	<b>4.72</b>	<b>1.37</b>	<b>4.04</b>	<b>8.10</b>

Source of Data: TransCo and NGCP

\* From 2001 to 2006 excludes demand of Panay Electric Company(PPC) in Visayas Grid

Visayas demand increased due to PPC synchronized to the system on 6 June 2007.

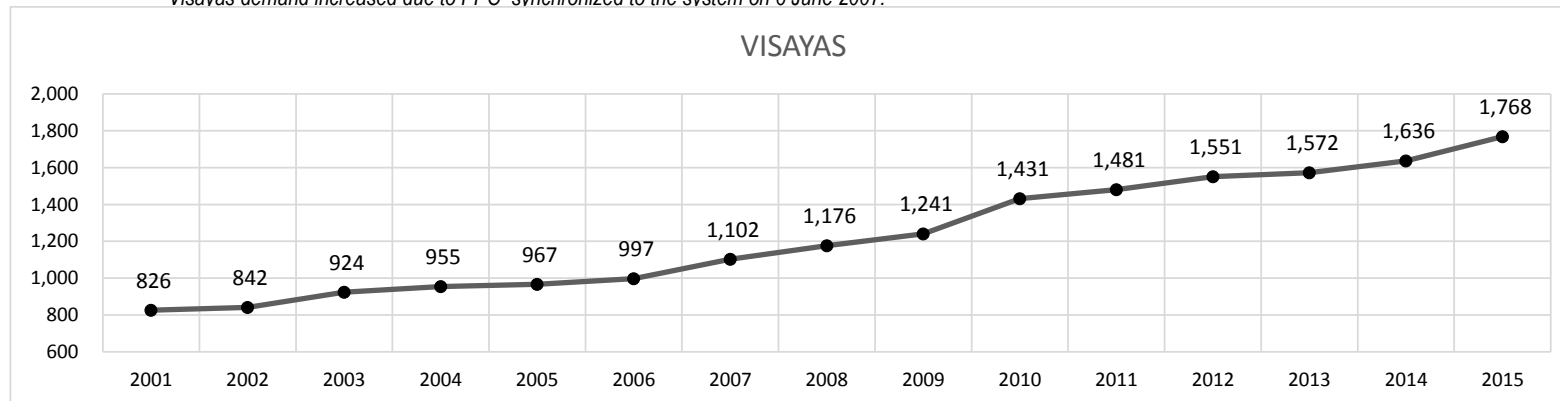

# MONTHLY SYSTEM PEAK DEMAND

( in MW)



MONTH	MINDANAO														
	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015
JAN	887	911	946	1,058	1,082	1,062	1,108	1,158	1,143	1,240	1,250	1,270	1,284	1,354	1,387
FEB	900	913	918	1,044	1,082	1,077	1,141	1,146	1,163	1,180	1,231	1,191	1,244	1,351	1,380
MAR	903	900	978	1,027	1,082	1,088	1,177	1,162	1,158	1,026	1,219	1,244	1,245	1,344	1,370
APR	887	927	985	1,051	1,087	1,090	1,167	1,190	1,186	1,009	1,253	1,232	1,226	1,310	1,406
MAY	901	920	1,001	1,099	1,055	1,118	1,109	1,159	1,194	1,211	1,253	1,301	1,366	1,339	1,438
JUN	897	931	1,021	1,035	1,072	1,100	1,145	1,188	1,220	1,238	1,264	1,309	1,364	1,416	1,435
JUL	894	924	976	1,025	1,045	1,093	1,141	1,163	1,198	1,214	1,298	1,289	1,384	1,390	1,397
AUG	926	941	980	1,086	1,061	1,119	1,141	1,147	1,208	1,221	1,290	1,306	1,326	1,386	1,446
SEP	947	927	995	1,102	1,078	1,090	1,203	1,163	1,217	1,235	1,288	1,268	1,256	1,391	1,453
OCT	954	950	1,019	1,134	1,122	1,130	1,193	1,156	1,292	1,263	1,290	1,319	1,219	1,441	1,507
NOV	938	965	1,051	1,155	1,149	1,147	1,158	1,204	1,303	1,286	1,326	1,321	1,397	1,469	1,517
DEC	933	995	1,131	1,177	1,105	1,228	1,241	1,175	1,282	1,288	1,346	1,318	1,428	1,453	1,510
<b>MAX</b>	<b>954</b>	<b>995</b>	<b>1,131</b>	<b>1,177</b>	<b>1,149</b>	<b>1,228</b>	<b>1,241</b>	<b>1,204</b>	<b>1,303</b>	<b>1,288</b>	<b>1,346</b>	<b>1,321</b>	<b>1,428</b>	<b>1,469</b>	<b>1,517</b>
<b>% AAGR</b>	<b>1.60</b>	<b>4.30</b>	<b>13.67</b>	<b>4.09</b>	<b>(2.40)</b>	<b>6.88</b>	<b>1.09</b>	<b>(3.04)</b>	<b>8.27</b>	<b>(1.18)</b>	<b>4.54</b>	<b>(1.87)</b>	<b>8.08</b>	<b>2.89</b>	<b>3.29</b>

Source of Data: TransCo and NGCP

